


Submittal Data: TM24F	ITDI	24,000 BTU			
Job Name		Location		Date	
Purchaser		Engineer			
Submitted To		For	Reference	☐ Approval	Construction
Unit Designation		Schedule N			
GENERAL FEATURES					
-Floor Stand or Ceiling Mount					
-Quiet Operation -Multi-Speed Fan					
-4-way Discharge Air Flow					
-Swing Louvers					
-Remote Control Lockout					
-Wireless Remote Controllers					
-XK-19 Wired and Wireless Remote Conti	rollers				
-Limited 5 yr. Parts Warranty					
System Rati	Physical Specifications				
Cooling*					
Rated Capacity	22,800 BTU/H	Unit Dimens	ions (LxHxD)		48.0 x 27.5 x 8.9 -in
Heating*					
Rated Capacity	27,300 BTU/H	Weight (Net	/Shipping)		100/120 LBS
Sound Pressure (Hi/Lo)**		Drain Size (OI	0)		0.67-in
Cooling	48/44 dbA				17-mm
Heating	48/44 dbA				
Air Flow (min/max)					
Indoor Fan	412/736 CFM				
			- •		
Electrical Ra	tings		Refrige	rant Piping Da	ta
Fan Motor		Dofrigorant -	Typo		R410A
Output Power	145 W	Refrigerant ⁻	i yh <u>c</u>		K41UA
•		Coo Dino Cir	70 (OD)		5/8-in
FLA	0.63 A	Gas Pipe Siz	ze (OD)		2/8-111
Dower Supply		Liquid Dina	Sizo (OD)		ე/∩ : _∽
Power Supply	200/220 V 1 Dhana / 0 U-	Liquid Pipe S	SIZE (UD)		3/8-in
Normal Operational Voltage	208/230 V, 1 Phase, 60 Hz	Connactic	Mothod		ГIа J
Voltage Range	187 - 253 V	Connection	vietnou		Flared
MCA Interconnecting Cable Wire Size	1.0 A				
Interconnecting Cable Wire Size	14-4 AWG	* - 1 100		IDI 010/040	
			s are based on Al		Γ0
			ratings are per AF	IRI 270 and AHRI 3	50
RANOZA	AHR	CERTIFIED TO WWw.abridirectory.org			(ETD)
non-cause-depleting-refrigerent	,				Z/STED

24,000 BTUH MODEL

Model # FLR24HP230V1AF 24,000 BTUH 230V

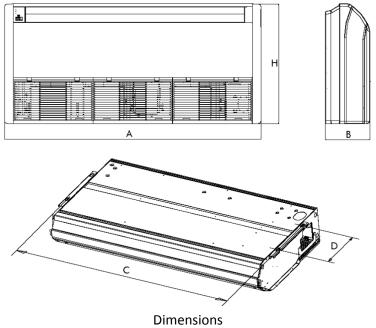



(mm)
(inches)


Α	В	С	D	Н	Н
1220	225	1158	280	700	700
48.0	8.9	45.6	11.0	27.6	27.6


Note: Size refrigerant lines based on evaporator port sizes.

MINIMUM CLEARANCE









Notes

- 1. Recommended Interconnecting Cable Type Stranded Bare Copper Conductors THHN 600V Unshielded Wire
- 2. Power wiring cable size must comply with applicable national and local codes.
- 3. Test conditions are based on AHRI 210/240.